



COMPLETE SOLUTION FOR MONITORING OF TEMPERATURE. HUMIDITY, PRESSURE AND OTHER VALUES IN THESE FIELDS:

- Food and beverages industry (HACCP)
- Pharmaceutical industry
- Blood stations, pharmacies
- Horticulture and cultivation of plants
- HVAC (heating, ventilation, air conditioning, cooling
- Building and energy management
- Research and development
- Laboratories (GLP)



Sixteen channel dataloggers are designed for recording of values from transducers of variety of quantities, alarm state indication, and process control. Parameters of inputs are defined by the types of installed input modules. Datalogger with transducers configured accordingly to client order can measure analog signals, frequency, count impulses, evaluate two-state quantities and read data from devices compatible with ADAM Advantech protocol (ModBus is under preparation). Data is ready to download to a personal computer anytime via USB, RS232, RS485, Ethernet or GSM modem. Analyzing of the record is enabled after data download to the PC by means of the included program.

#### NEW FIRMWARE AND SOFTWARE ENABLE ESPECIALLY TO:

- Configure individually each input channel for measurement, alarm evaluation and data logging, including individual logging interval for each input.
- Each input channel can be individually programmed for different modes of record (continuous record, time dependent record, record only if specified logic conditions are matched, record triggered by external signal, etc.). It is enabled to record with shorter interval in case, measured values match previously defined conditions e.g. to map in detail trouble state. It is also enabled to memorize actual value and time if defined time event appears.
- Set up to four different logic conditions for each channel to activate alarm. Each condition compares measured values from inputs with set limits. It is possible to set hysteresis and delay of condition validity. Also weekly program can be set and distant condition from the PC.
- Indicate alarm states visually, audibly, by relay contact, by e-mail or SMS message.
- Control processes by means of the optional relay module enabling to switch 16 output relays depending on alarm states.
- Receive information from data logger by means of SMS messages via GSM modem actual values, alarms, memory occupation and other.
- · Assign to each input channel name of actual recorded process to identify monitored object (e.g. type of monitored product). It is enabled to select this name from data logger keyboard during the operation.
- Store several configuration profiles (all logger parameters setting) for different measuring tasks and select profiles from MS5D logger keyboard or optional external terminal.
- Change easily input modules if different input signals are required for measurement.
- To connect input signals easily to removeable terminal connector. Each input channel is equipped with three terminals including shielding.



### Following data loggers are available:



- MS5D completely equipped data logger
  - dual line alphanumeric LCD display
  - -four control buttons
  - -32 alarm LEDs



MS5

- -all functions as MS5D data logger
- without dual line alphanumeric LCD display
- -without control buttons
- -without 32 alarm LEDs
- -common alarm indication with one LED



#### **ARCHITECTURE OF MONITORING SYSTEM:**

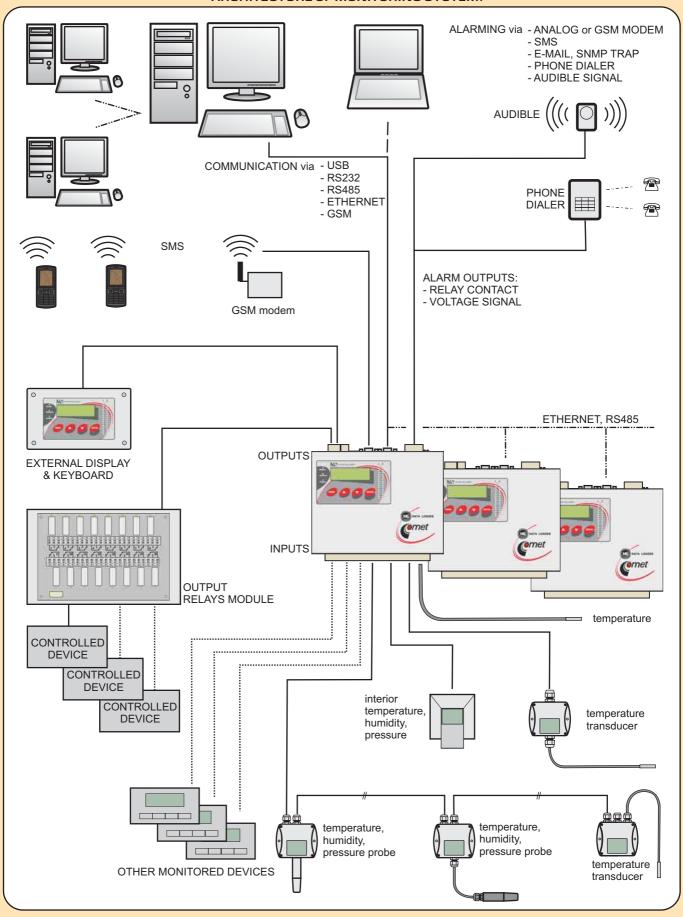




	TABLE OF INPUTS					
TYPE	MEASURED VALUE	ACCURACY	NOTE			
AO	dc current 4 to 20 mA	±0.1% FS	With source approximately 21V for two-wire transducers with current loop (e.g. temperature and humidity transducers Comet). Only galvanically not isolated.			
A1*	dc current 4 to 20 mA	±0.1% FS	for passive sensing of current			
BO*	dc current 0 to 20 mA	±0.1% FS				
B1*	dc current 0 to 1A	±0.1% FS				
B2*	dc current 0 to 5A	±0.1% FS				
CO	ac current 0 to 20mA	±1% FS	galvanically isolated			
C1	ac current O to 1A	±1% FS	galvanically isolated			
C2	ac current 0 to 5A	±1% FS	galvanically isolated			
DO*	dc voltage O to 100mV	±0.1% FS				
D1*	dc voltage O to 1V	±0.1% FS				
D2*	dc voltage O to 10V	±0.1% FS				
D5*	dc voltage -10 to +10V	±0.1% FS (±20mV)	New !			
D4*	dc voltage +75V	±0.1% FS	New !			
EO	ac voltage 0 to 100mV	±1% FS	galvanically isolated			
E1	ac voltage O to 1V	±1% FS	galvanically isolated			
E2	ac voltage O to 10V	±1% FS	galvanically isolated			
E4	ac voltage O to 50V	±1% FS	New! galvanically isolated			
F*	measurement of resistance	±0.1% FS	two-wire connection			
J*	input for Nickel RTD temperature sensor Ni1000, 6180 ppm/°C, range -50 to +250°C	-50 to 100°C±0.2°C 100 to 250°C ±0.2% from reading	two-wire connection			
K*	input for Platinum RTD temperature sensor Pt100, range -140 to +600°C	-140 to+100°C ±0.2°C 100 to 600°C±0.2% from reading	two-wire connection			
K1*	input for Platinum RTD temperature sensor Pt1000, range -140 to +600°C	-140 to+100°C ±0.2°C 100 to 600°C ±0.2% from reading	two-wire connection available also with sensors and transmitters			
КЗ	precise input for RTD temperature sensor Pt1000, range -10 to +50°C	±0.06°C	<b>New!</b> Two-wire connection. Only galvanically not isolated. Available also with sensors.			
N*	thermocouple K (NiCr-Ni) range -70 to +1300°C	±(0.3% + 1.5°C) from reading	linearized, cold junction compensation			
T*	thermocouple T (Cu-CuNi) range -200 to +400°C	±(0.3% + 1.5°C) from reading	linearized, cold junction compensation			
0*	thermocouple J (Fe-Co) range -200 to +750°C	±(0.3% + 1.5°C) from reading	linearized, cold junction compensation			
P*	thermocouple S (Pt10%Rh-Pt), range 0 to +1700°C	±(0.3% + 1.5°C) from reading from +200 to +1700°C	linearized, cold junction compensation			
Q*	thermocouple B (Pt30%Rh-Pt), range +100 to +1800°C	±(0.3% + 1°C) from reading from +300 to +1800°C	linearized, without cold junction compensation			
S*	binary input for potential-less contact	maximum resistance of closed con				
L		minimum duration for recording: 2				
S1	binary voltage input	state: 1 to 9mA - depending on the				
	counton input for voltage signal		change: 200ms, galvanically isolated			
CTU	counter input for voltage signal	voltage for "HIGH" state (for counte maximum pulse frequency 5kHz, ba	er status change]: 3 to 24Vdc, acked-up operation, galvanically isolated			
CTK	counter input for potential-less contact and open collector	maximum pulse frequency 5kHz, programmable filter of pulse open collector ringing, backed-up operation during power mains failure, maximum resistance of				
	·		g power mains failure, maximum resistance of impression resistance of open contact: 250 kohms,			
FU	input for measurement of frequency		cy ±(0.2% from reading + 1Hz), input voltage for			
	voltage signal		nt in state "H": approximately 7mA, minimum			
FK	input for measurement of frequency	Oto Fills and the	10.00% frame a 21.			
	contact switching		y ±(0.2% from reading + 1Hz), maximum			
	Cosado ovilos in ig		hms, minimum resistance of open contact: 250			
ļ		kohms, minimum duration of input p				
RP	input for serial signal RS485 for devices		ansmitters Tx4xx with RS485 digital output.			
1111	supporting Modbus RTU or Advantech	Galvanically isolated. Maximum spe	eed 1152UUBd.			

Notes: Inputs marked (\*) are not galvanically isolated and have common ground. These inputs are available also as galvanic isolated. Galvanic isolated analog inputs are marked with letter G following the name of input type (e.g. input for passive measurement of current 4-20mA - type A1 - with galvanic isolation is marked A1G). Galvanic isolation is not designed as safety protection.




### PROGRAM FOR PERSONAL COMPUTER

Setting of all system parameters and the stored data processing is performed by the PC software for Windows.


- Included software freeware is possible to download free from www.cometsystem.cz. It enables to communicate with logger through a serial RS232 link or through an RS485 network (long distance or several networked loggers), via USB, by means of modems (line or GSM) or via optional Ethernet interface. It also enables to configure the logger, read recorded values and display actual values of the inputs. It is possible to view and print recorded values in numeric format and export to dbf format for consequent analysis in any data processor (e.g. MS Excel). Free program version does not work with graphs.
- Optional software for Windows is also available. Program has all functions as free program. In addition optional software enables:
  - most complex graphic processing of recorded data including any zooming of time and vertical axes
  - on-line graphic visualization of curves with selectable refresh interval the Display Mode
  - -the Distant Display Mode on Internet / Ethernet network
  - direct record of the Display Mode to the PC
  - automatic data download to the PC in preprogrammed intervals
  - -automatic data export to the PC in preprogrammed intervals in dbf format
  - -record of data to the network
  - -administration of users and passeords
  - -other functions

TECHNICAL PARAMETERS					
Memory type:	internal SRAM, backed-up by Lithium battery				
Total memory capacity:	2MB (up to 480 000 values)				
Logging mode:	noncyclic logging stops after filling the memory				
	cyclic after filling memory oldest data is overwritten by new				
Logging interval:	adjustable individually for all input channels from 1 second to 24 hours				
Real time clock:	year, leap year, month, day, hour, minute, second, backed-up by Lithium battery				
Input measured values	are defined for each channel by installed input modules (see table) accordingly to				
(1 to 16 channels):	user requirements				
AD converter (analog channels):	16 bits, conversion duration approximately 60ms/channel				
Interfaces for communication with	RS232 (RxD,TxD,RTS,CTS,GND), cable up to 15 m - included. Enables direct				
computer:	connection to the computer or via land line modem and GSM modem.				
	USB interface - included				
	RS485 - cable up to 1200 m, galvanically isolated, possibility of connection of				
	several data loggers to one communication link - included				
Supported communication speeds:	Ethernet interface LAN - optional				
Output for alarm indication:	9600, 19200, 57600, 115200 Bd				
Output for alarm mulcation.	1) Red LED at the side of the case, 32 LEDs - only MS5D data logger 2) Relay max. 8A/250Vac, switching-over contact				
	3) Voltage signal OV/4.8V, maximum current 50mA, output designed for				
	connection of external audio indication unit or telephone voice dialer				
	4) Alarm can be signalled also by e-mailu message, SNMP trap, SMS - please				
	see optional accessory				
Power:	9 to 30Vdc, 24Vdc recommended				
Operating temperature range:	0 to +50°C				
Dimensions including connectors:	215 x 225 x 60 mm				
Protection:	IP2O				
Warranty:	2 years				

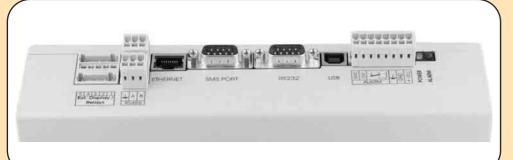

Power and communication connectors, alarm outputs




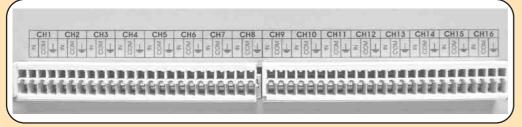

Terminals for input signal connection - each input has three terminals including shielding

Included accessory: Traceable calibration certificate from the manufacturer, instruction manual. Calibration certificate with declared metrological traceability of etalons is based on requirements of EN ISO/IEC 17025 standard. Included is also communication cable for RS232 2meters long, free Windows program (also downloadable for free from www.cometsystem. cz). Program enables to read recorded values and display actual values of the inputs. It is possible to view and print recorded values in numeric format and export to dbf format.

### Optional accessory:

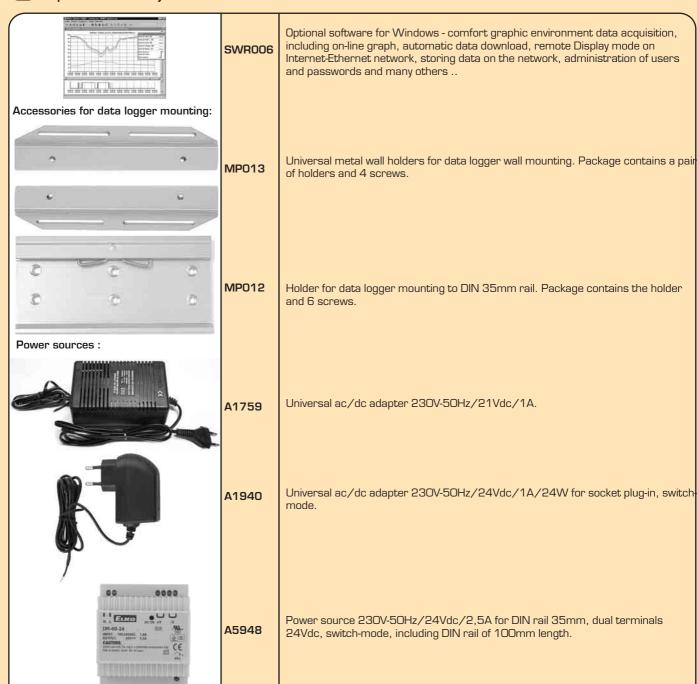



#### Backup power supplies:



A6963 supply

A7963

battery

Backup power supply A6963, model MINI-DC-UPS/24DC/2 with batery A7963, model MINI-BAT/24DC/1.3AH, manufacturer Phoenix Contact.

Power supply is designed for mounting to 35mm DIN rail in data logger case MP033 and MP034.

It contains two modules - UPS and battery.

Included is a DIN rail for mounting to the case. Power supply is delivered uninstalled in original manufacturer packaging.

Backup power supply is able to supply data logger system with 200 mA consumption at least 3 hours, data logger system with 500 mA consumption at least 2 hours, data logger system with 1A consumption at least one hour.

Discharged accumulators are recharged to full capacity in approximately 3 hours. System enables to inform user on switch-over to battery operation.

More details are in Manual Appendixes.

For mounting to MP033 or MP034 case please order: 1pc A6963, 1pc A7963, 1pc MP035 rail.

\* 5

MP035

MP035 DIN rail 35mm of 226mm length with screws for mounting of A6963 power supply with A7963 batery to MP033 or MP034 case.



A6966 supply

A7966 battery Backup power supply A6966, model AWZ224, manufacturer Pulsar sp.j., Poland. To this power supply it is necessary to buy two lead accumulators A7966 12V/7Ah in hermetical maintenance-free type of construction, e.g. type ELNIKA 12V/7.2Ah. Power supply is designed for mounting to vertical inflammable wall with sufficient air flow. Its protection rate is IP20. It is not designed for mounting to closed switchboard. This backup power supply is able to supply data logger with transmitters of current consumption 200mA for approximately 35 hours. Discharged accumulators are recharged to full capacity in approximately 14 hours.

System enables to inform user on switch-over to battery operation.

More details are in Manual Appendixes.

Please order: 1pc A6966, 2pcs A7966.



### Optional internal equipment: Built-in independent SMS port for GSM modem connection for SMS reception and sending. Enables to receive information from data logger by means of SMS MP024 messages - actual values, alarms, memory occupation and others - as a response SMS port RS232 to SMS query from user or in case of alarm creation at data logger. Ethernet Not necessary, if data logger is connected to the PC via GSM modem. Built-in LAN interface for data logger connection to Ethernet network. In case of MP025 limits exceeding alarm is activated and warning e-mail or SNMP trap are sent to Ethernet SMS PORT specified addresses. External communication converters: Converter RS485/RS232 for serial port COMx at the PC side, including ac/dc M0021 adapter and terminator T485. Converter USB/RS485 for USB port at the PC side, including terminator T485. MP022 Powered from computer USB interface. Converter Ethernet/RS485 ncluding ac/dc adapter and terminator T485. MP023 Designed for several data loggers conencted via RS485 network for connection to the computer via Ethernet. Accessories for ALARM OUT output: External audio indication unit. Enables to signal alarm state acoustically at the MP026 location up to 50m from data logger. Audio unit is connected to data logger by a cable (not included). 1 2 3 2 MP002 4 5 5 6 Telephone voice dialer for alarm reporting, ac/dc adapter included. Enables in 7 8 9 -ALARM OUT output activity to send voice report to selected telephone numbers. \* 0 # 6 Voice dialer is connected to land line. Output relays module: MP018 Output relays module with interconnection cable. It contains 16 mains relays 250V/8A with switching-over contacts. Each relay can be control based on alarm creatione at different input channels accordingly to setting of user program. Output relays are designed for external devices control (switching of heating,

cooling, ventilation, distant alarm etc.). It is necessary to order connection cable

to data logger MPO17, optionally other accessories.



	MP017	Connection cable for terminal with display and output relays module - cable length approximately 60cm. Longer cable lengths available - maximum 2m for relay module.
	MP013	Universal metal wall holders for data logger wall mounting. Package contains a pair of holders and 4 screws.
	MP019	Holder for relay module mounting to DIN 35mm rail. Package contains the holder and 6 plastic rivets.
	MP020	DIN rail for relay module with elevated consoles for mounting to the MPO33, MPO34 case. Rail enables to raise the relay module enables to lead cables to data logger under the module.
Terminals with display:		
9008	MP016	Terminal with dual line alphanumerical LCD and control buttons and 32 alarm LEDs - for panel mounting or mounting to a case lid. Identical functions as built-in terminal of MS5D data logger. It is possible to build in with IP54 protection. Maximum cable length to data logger 50m. It is necessary to order the MPO17 connection cable to data logger.
	MP017	Connection cable for terminal with display - cable length approximately 60cm. Longer cable lengths available - maximum 50m.
( ))	MP017-5	Connection cable for terminal with display - cable length 5m
	MP017-10	Connection cable for terminal with display - cable length 10m
	MP032	External terminal with dual line alphanumerical LCD and control buttons and 32 alarm LEDs - built in a IP54 protection case, including 2m cable with covered terminals. Identical functions as built-in terminal of MS5D data logger. Maximum
GSM modem and accessories:		cable length to data logger 50m.
Wavecom <sup>®</sup> HASTRACI	MP009	GSM modem WaveCom Fastrack M1306B, without accessories
	MP009/1	Antenna for GSM modem WaveCom Fastrack, right-angled
	MP009/2	Communication cable for GSM modem Fastrack
	MP009/3	Ac/dc adapter 230V/12V for GSM modem Fastrack



Covers, cables and other accessories:		
	MP027	Covers of data logger terminals (pair). Designed for aesthetic covering of cables connected to terminals and connectors. Magnetic fixing to data logger.
	MP007	USB connection cable A-B, 1,8m. Standard computer cable.
#0.01 -0.001 -0.001 -0.001 -0.001	MP030	RS232 connector with terminals for RS232 interface connection by means of terminals, not by D-Sub connector.
	MP031	Screwdriver for easy connection of cables to WAGO terminals
Assemblies in case with higher IP rate:		
	MP033	Case with IP65 protection with wall holders and data logger holders - no cutout in the lid. Dimensions 270 x 570 x 140 mm.
	MP034	Data logger MS5 in IP54 protection case with connected terminal with display built in the lid. Dimensions 270 x 570 x 140 mm.

Temperature, humidity, pressure transmitters Comet are directly compatible with MS data loggers. Also complete monitoring system with data logger and transmitters can be delivered.